DOWNRIVER WASTEWATER TREATMENT FACILITY

- (A) CLARIFIER BLDG. #6
- (B) RETURN ACTIVATED SLUDGE BLDG.
- (C) CLARIFIER BLDG. #5
- (D) CLARIFIER BLDG. #4
- (E) CLARIFIER BLDG. #3
- (F) CLARIFIER BLDG. #2
- (G) CLARIFIER BLDG. #1
- (H) SAMPLE BLDG.
- (I) SECONDARY OXYGEN CONTROL BLDG.
- (J) N. INFLUENT CHAMBER ENTRANCE HOUSE
- (K) S. INFLUENT CHAMBER ENTRANCE HOUSE
- (L) TRAIN "O" INFLUENT CHAMBER ENTRANCE HOUSE
- (M) SECONDARY CHEMICAL BLDG.
- (N) SECONDARY LOW LIFT PUMP STATION
- (O) MAINTENANCE BLDG.
- (P) STOCKROOM #1
- (Q) EMPLOYEE SERVICE BLDG.
- (R) DISSOLVED AIR FLOTATION (DAF) BLDG.
- (S) SOLIDS HANDLING BLDG.
- (T) SOLIDS THICKENING COMPLEX
- (U) MAINTENANCE GARAGE
- (V) SKIMMINGS PUMP BLDG.
- (W) SKIMMINGS BLDG. #5
- (X) SKIMMINGS BLDG. #1-3
- (Y) SKIMMINGS BLDG. #6
- (Z) SKIMMINGS BLDG. #2-4
- (AA) PRIMARY MOTOR CONTROL CENTER #1-6
- (BB) PRIMARY PUMP GALLERY
- (CC) PRIMARY PUMP GALLERY ENTRANCE HOUSE
- (DD) PRIMARY POLYMER BLDG.
- (EE) SKIMMINGS BLDG. #7
- (FF) PRIMARY MOTOR CONTROL CENTER #7
- (GG) ULTRAVIOLET DISINFECTION
- (HH) TUNNEL PUMP STATION
- (II) TUNNEL PUMP STATION ELECT. BLDG.
- (JJ) RECYCLE SAMPLE BLDG.
- (KK) AERATED GRIT BLDG.
- (LL) FERRIC CHLORIDE TANKS
- (MM) FERRIC CHLORIDE EQUIP. BLDG.
- (NN) WEST GRIT BLDG.
- (OO) FINE SCREENS BLDG.
- (PP) EAST GRIT BLDG.
- (QQ) INFLUENT PUMP STATION
- (RR) ADMINISTRATION BLDG.
- (SS) WATER METER BLDG. (3 SHOWN)
- (TT) OLD SOLIDS BLDG.
- (UU) DETRITORS
- (VV) OLD GREASE BURNER BLDG.
- (WW) AERATED GRIT TANKS
- (XX) AERATION TANKS
- (YY) PRIMARY TANKS #1-6
- (ZZ) PRIMARY TANK #7

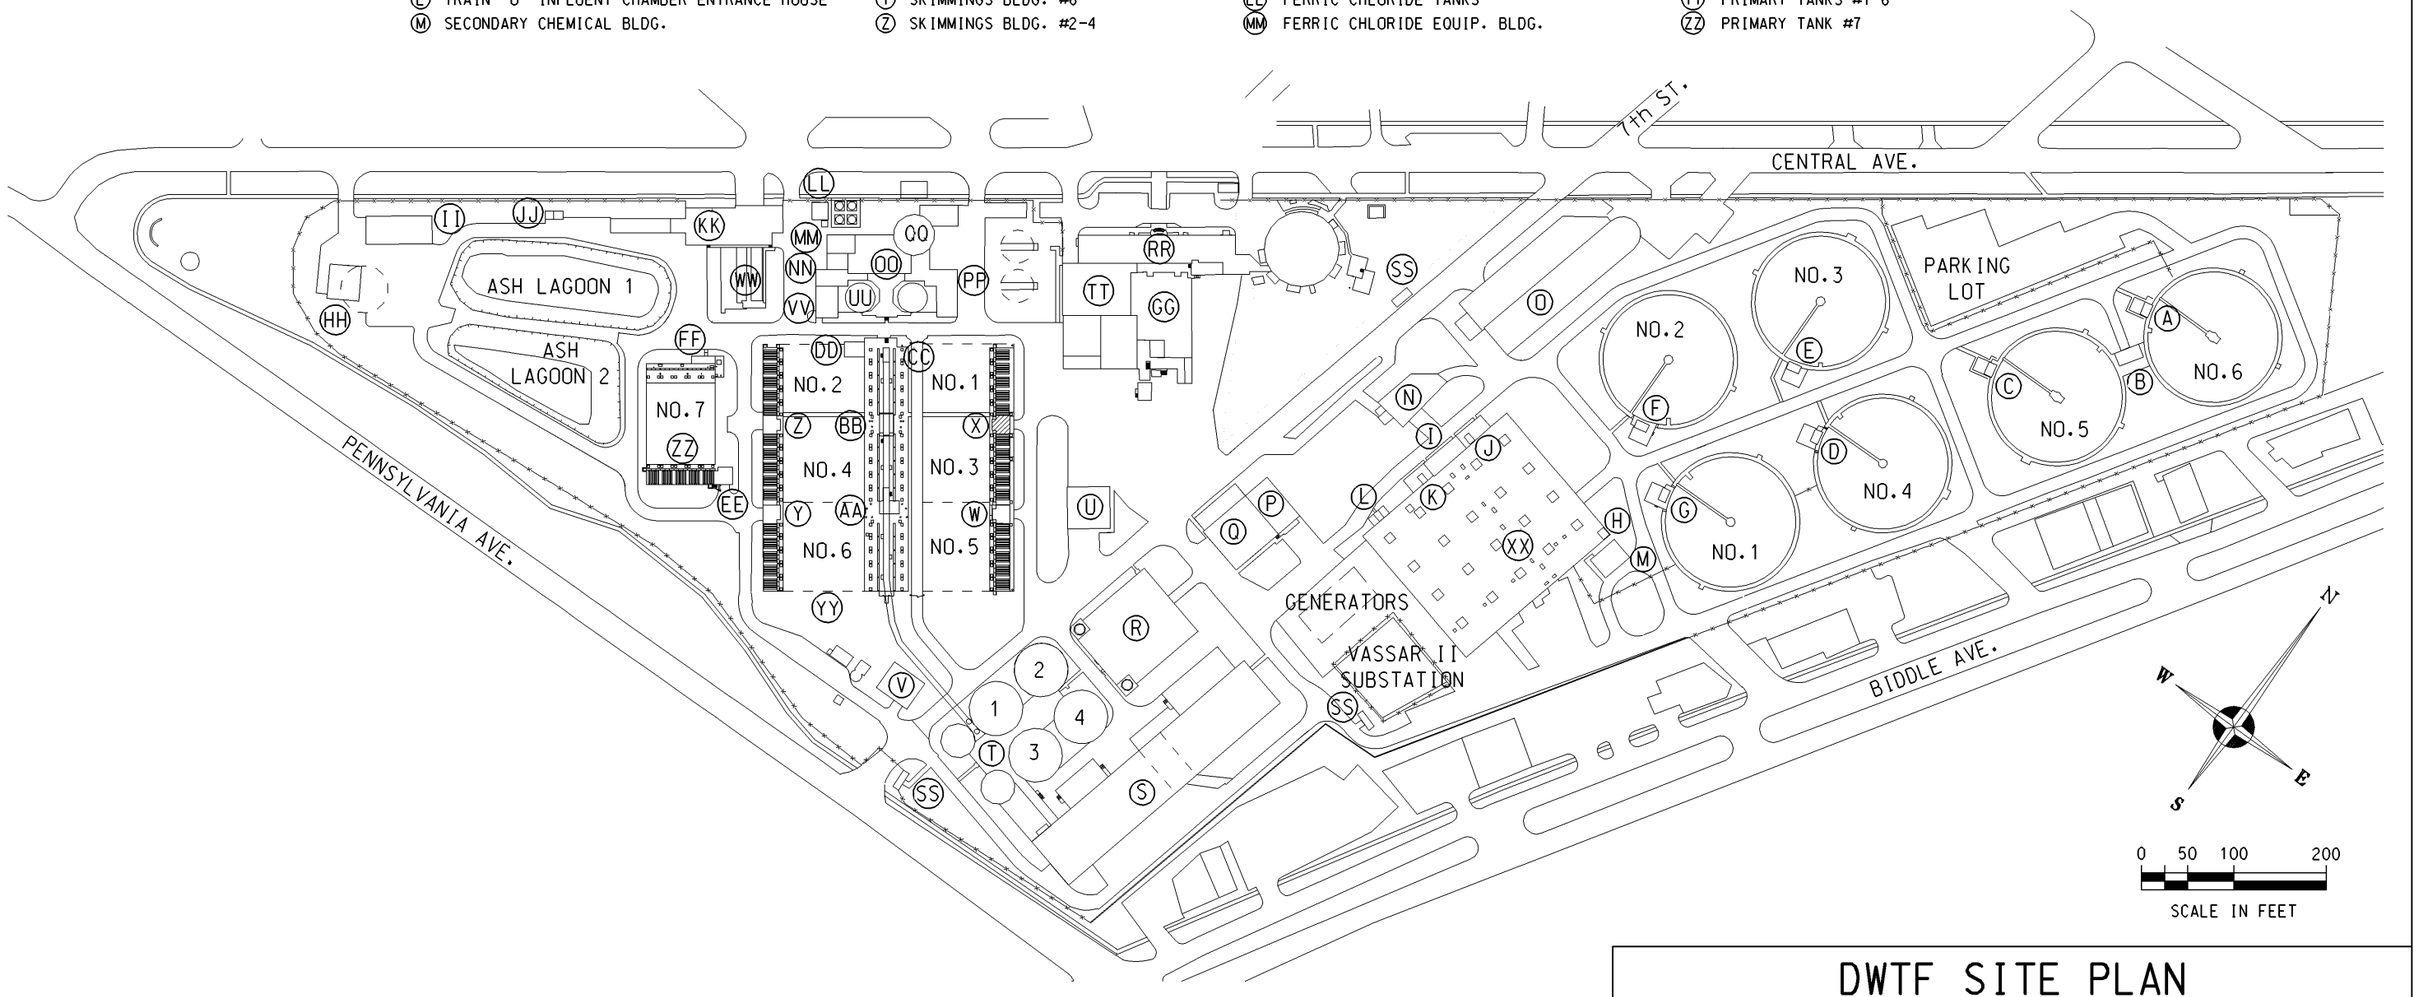

HRC

JOB NO. 20080550	HUBBELL, ROTH & CLARK, INC. CONSULTING ENGINEERS	FIGURE NO. 1-2
DATE DEC., 2009	220 BAGLEY DETROIT, MICH. SUITE 420 48226	

DWTF SITE PLAN

USER NAME = eporedes DESIGN FILE = \\200805\20080550\FIGURE_1-2.dgn QUEUE = \\plot\TIFFBW C:\R. TBL = I:\standards\MSI\Data\hrcolor2.tbPEN TBL = I:\standards\MSI\Data\hrcolor2.tbPEN TIME = 20-NOV-2009 08:07