
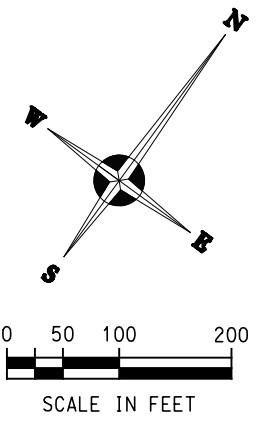


DOWNRIVER WASTEWATER TREATMENT FACILITY

- | | | | |
|--|---|---|--|
| <ul style="list-style-type: none"> Ⓐ CLARIFIER BLDG. #6 Ⓑ RETURN ACTIVATED SLUDGE BLDG. Ⓒ CLARIFIER BLDG. #5 Ⓓ CLARIFIER BLDG. #4 Ⓔ CLARIFIER BLDG. #3 Ⓕ CLARIFIER BLDG. #2 Ⓖ CLARIFIER BLDG. #1 Ⓗ SAMPLE BLDG. Ⓙ SECONDARY OXYGEN CONTROL BLDG. Ⓜ N. INFLUENT CHAMBER ENTRANCE HOUSE Ⓚ S. INFLUENT CHAMBER ENTRANCE HOUSE Ⓛ TRAIN "O" INFLUENT CHAMBER ENTRANCE HOUSE Ⓜ SECONDARY CHEMICAL BLDG. | <ul style="list-style-type: none"> Ⓝ SECONDARY LOW LIFT PUMP STATION Ⓞ MAINTENANCE BLDG. Ⓟ STOCKROOM #1 Ⓠ EMPLOYEE SERVICE BLDG. Ⓡ DISSOLVED AIR FLOTATION (DAF) BLDG. Ⓢ SOLIDS HANDLING BLDG. Ⓣ SOLIDS THICKENING COMPLEX Ⓤ MAINTENANCE GARAGE Ⓥ SKIMMINGS PUMP BLDG. Ⓦ SKIMMINGS BLDG. #5 Ⓧ SKIMMINGS BLDG. #1-3 Ⓨ SKIMMINGS BLDG. #6 Ⓩ SKIMMINGS BLDG. #2-4 | <ul style="list-style-type: none"> ⒶⒶ PRIMARY MOTOR CONTROL CENTER #1-6 ⒷⒷ PRIMARY PUMP GALLERY ⒸⒸ PRIMARY PUMP GALLERY ENTRANCE HOUSE ⒹⒹ PRIMARY POLYMER BLDG. ⒺⒺ SKIMMINGS BLDG. #7 ⒻⒻ PRIMARY MOTOR CONTROL CENTER #7 ⒼⒼ ULTRAVIOLET DISINFECTION ⒽⒽ TUNNEL PUMP STATION ⒿⒿ TUNNEL PUMP STATION ELECT. BLDG. ⓂⓂ RECYCLE SAMPLE BLDG. ⓀⓀ AERATED GRIT BLDG. ⓁⓁ FERRIC CHLORIDE TANKS ⓂⓂ FERRIC CHLORIDE EQUIP. BLDG. | <ul style="list-style-type: none"> ⓃⓃ WEST GRIT BLDG. ⓄⓄ FINE SCREENS BLDG. ⓅⓅ EAST GRIT BLDG. ⓆⓆ INFLUENT PUMP STATION ⓇⓇ ADMINISTRATION BLDG. ⓈⓈ WATER METER BLDG. (3 SHOWN) ⓉⓉ OLD SOLIDS BLDG. ⓊⓊ DETRITORS ⓋⓋ OLD GREASE BURNER BLDG. ⓌⓌ AERATED GRIT TANKS ⓍⓍ AERATION TANKS ⓎⓎ PRIMARY TANKS #1-6 ⓏⓏ PRIMARY TANK #7 |
|--|---|---|--|

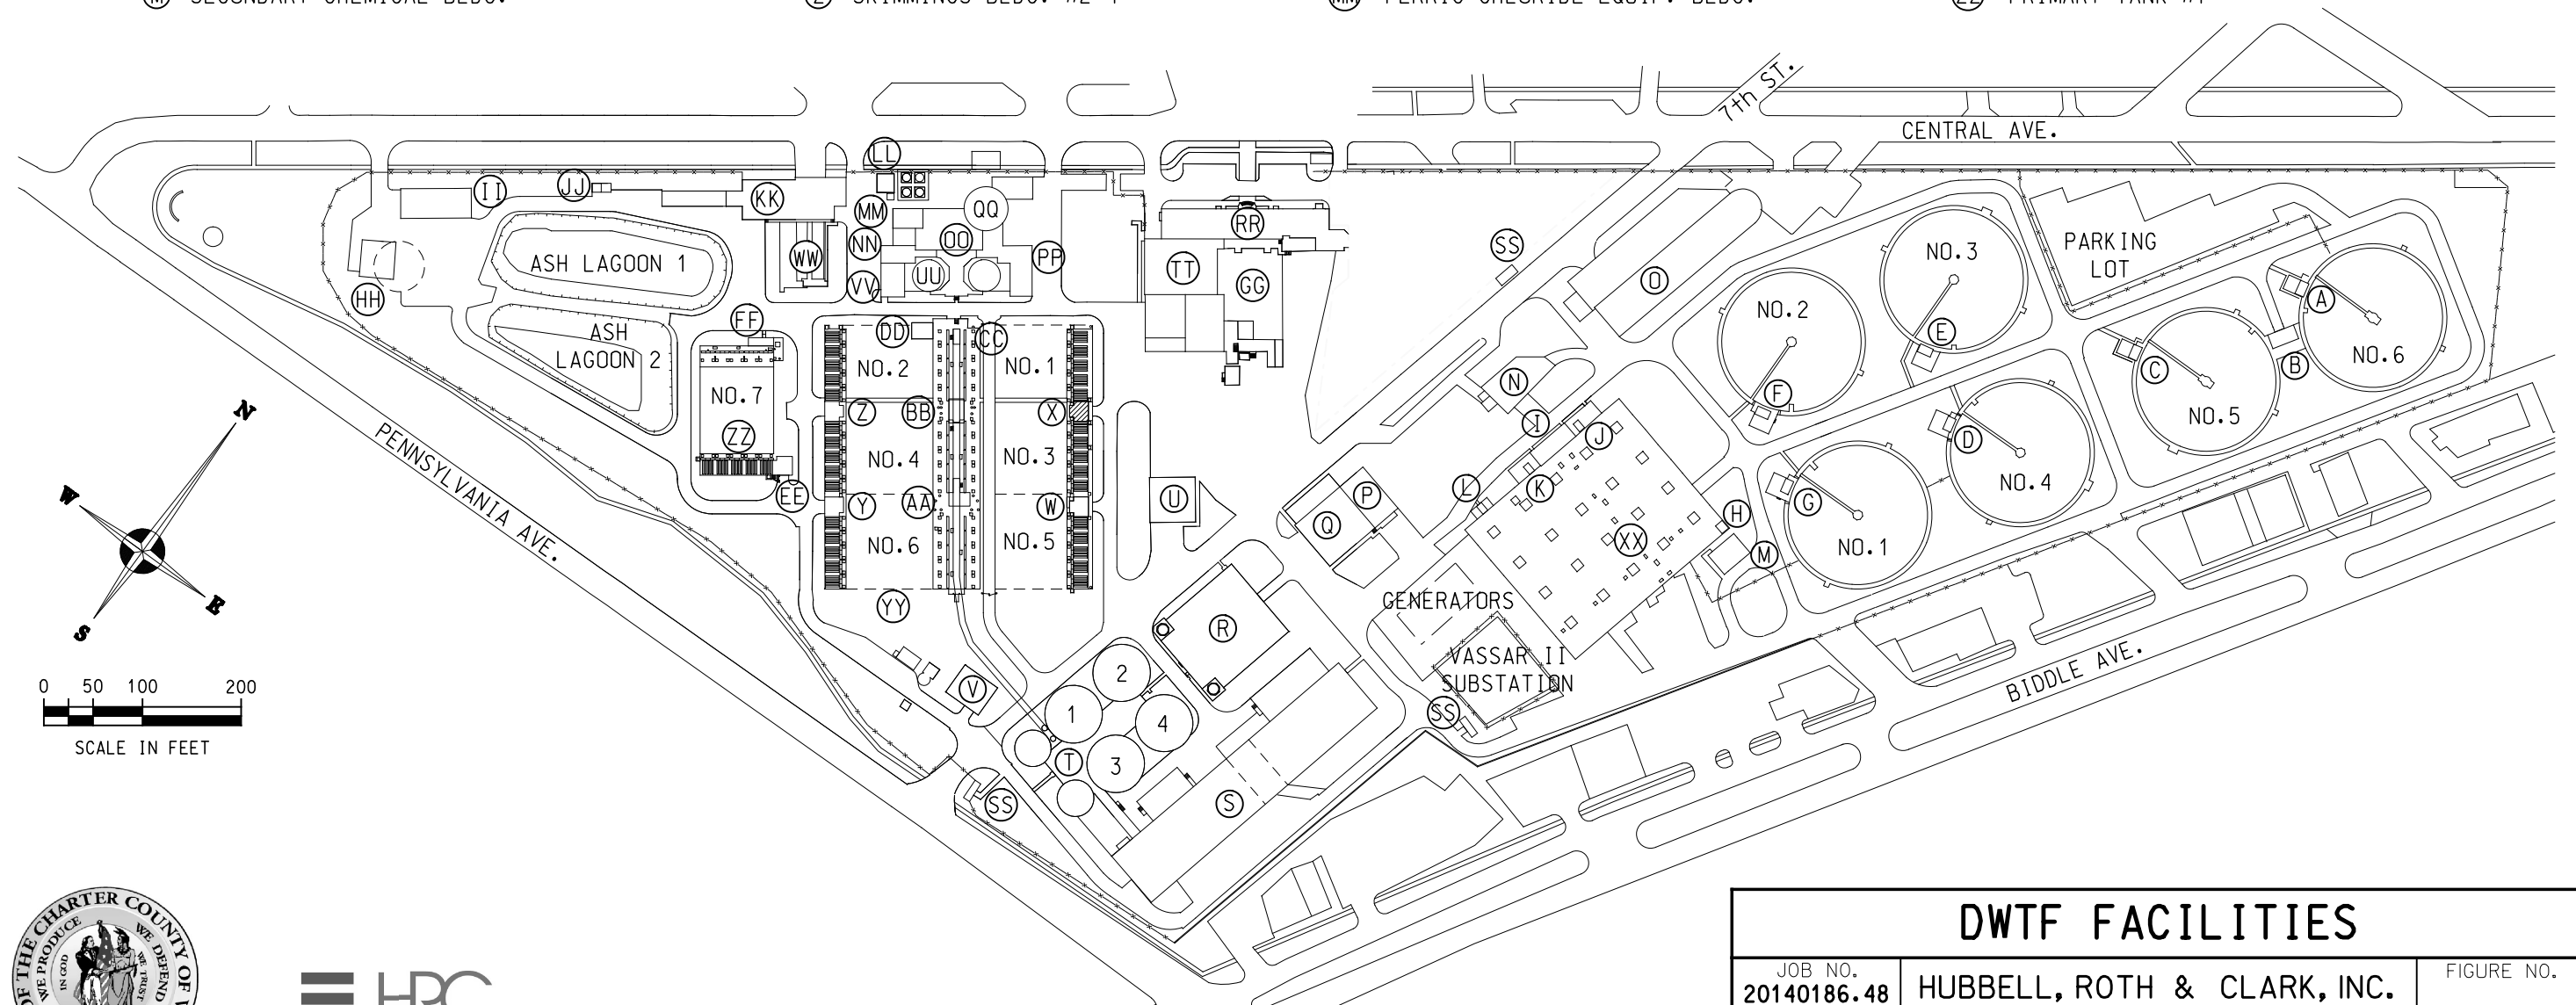

HRC
HUBBELL, ROTH & CLARK, INC.
 CONSULTING ENGINEERS SINCE 1915

DWTF FACILITIES		
JOB NO. 20140186.48	HUBBELL, ROTH & CLARK, INC.	FIGURE NO. 1
DATE 12-7-17	CONSULTING ENGINEERS 535 GRISWOLD STREET DETROIT, MICH.	SUITE 1650 48226-3698